


Solar Systems from Schweizer

PV Mounting System Installation Instructions

Pitched Roof MSP-PR

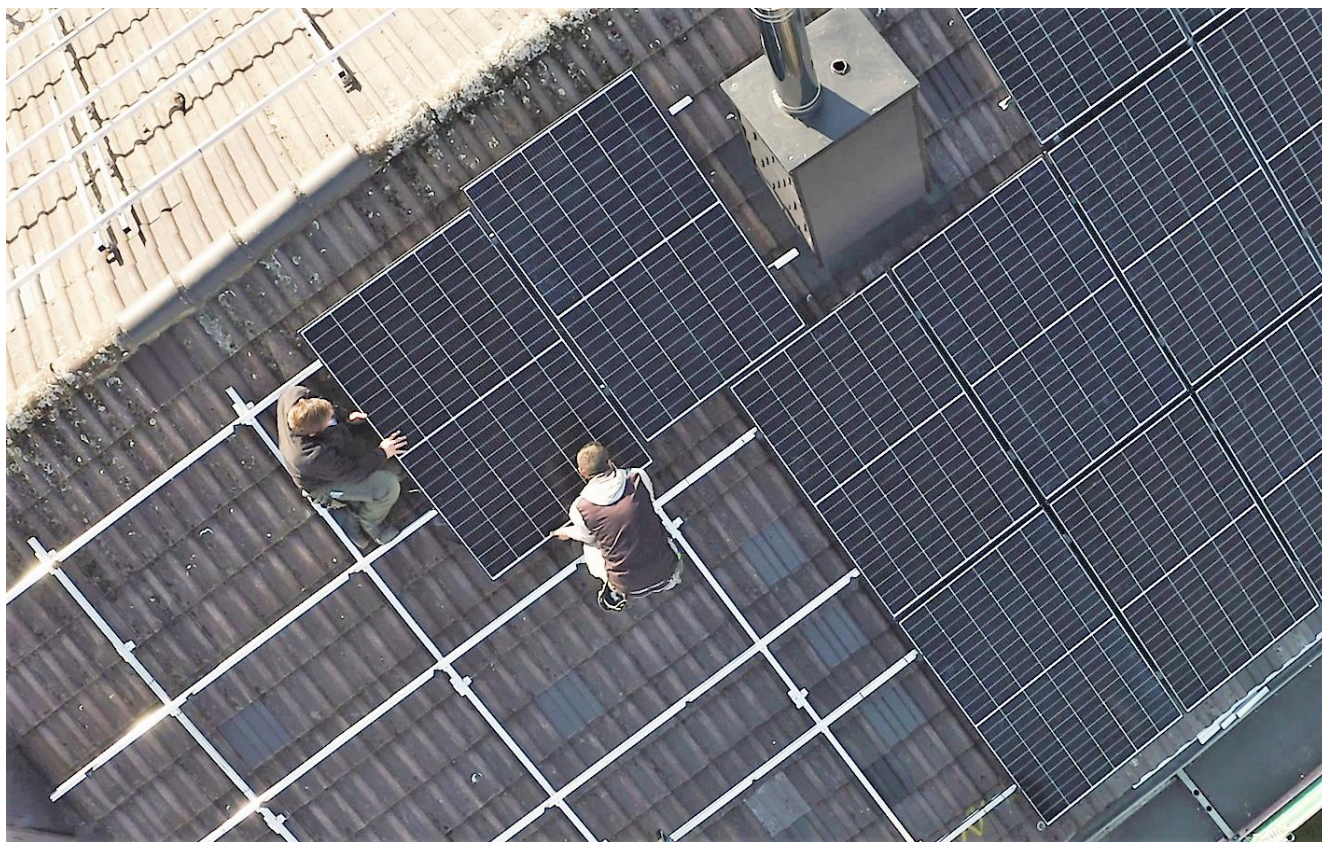

Read carefully before use and keep in a safe place.

All information and illustrations are up to date at the time of publication.

The current version can be downloaded at any time at [Installation instructions MSP-PR](#).

Copyrights and all other property rights to the contents of these installation instructions remain entirely the property of Ernst Schweizer AG.

Reprinting, including of extracts, is only permitted with our prior consent.

© 2024 Ernst Schweizer AG – Subject to technical changes and errors

1	About these instructions	3
1.1	Basic information concerning the installation instructions	3
1.2	Structure of warnings according to hazard levels	3
2	Caption key to installation instructions	4
3	Copyright.....	4
3.1	Reservation of rights	4
3.2	Liability	4
4	Safety	4
4.1	Intended use	4
4.2	Reasonably foreseeable misuse	5
4.3	Requirements for safe operation.....	5
4.4	Responsibility of the customer or installer	6
4.5	Basic safety instructions	7
5	Residual risks	8
6	Technical clarification prior to commencing installation.....	9
7	Roof preparation.....	9
8	Commissioning and maintenance	9
9	Installation conditions	10
10	Additional documents.....	11
11	Required tools	11
12	Components.....	12
13	Preparation – the following must be realised before assembly:.....	13
14	Assembly.....	14
14.1	Detail of dilatation joint support profile MSP-PR-CH	16
15	Appendix 1 Mounting cross connector MSP-PR-CC	17
16	Appendix 2 Mounting hanger bolt MSP-PR-HB.....	18
17	Appendix 3 Mounting adapter plate MSP-PR-HBP	19
18	Appendix 4 Mounting the sheet metal clamp MSP-PR-SC 70.....	20
18.1	Appendix 5 Installation of sheet metal seam clamp MSP-PR-SC 70 on a copper roof with a stainless steel saddle MSP-PR-SCC 40	21
18.2	Note on mounting the stainless steel saddle MSP-PR-SCC 40	21

1 About these instructions

1.1 Basic information concerning the installation instructions


The installation instructions contain important information on how to install the mounting system safely, properly and correctly. Following the instructions avoids hazards and reduces repair costs and downtimes. These installation instructions must be retained throughout the entire PV mounting system installation period for reference purposes.

Applicable documents are listed in the appendix (**Chapter 10 Additional documents**).







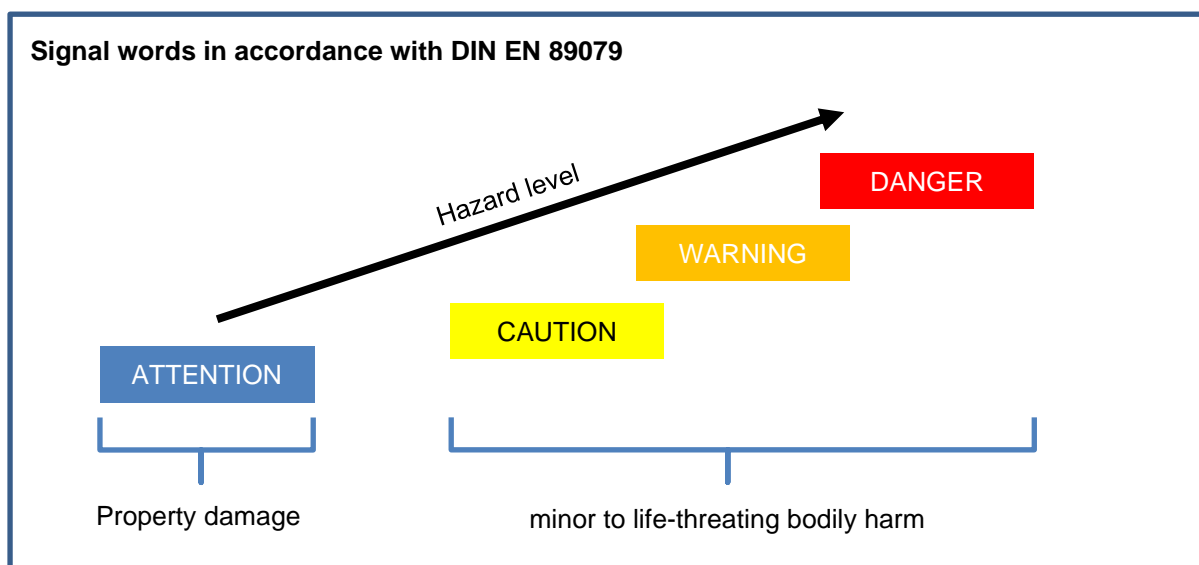


1.2 Structure of warnings according to hazard levels

Differentiation of hazard levels

The following signal words indicate different hazard levels through different coloured backgrounds:



2 Caption key to installation instructions

	Attention		Check for potential sources of error
	See project report		Audible click
	Correct execution		Direction of movement
	Faulty execution		Tightening / Tightening torque
Option	Optional step		Earthing / Earthing installation

3 Copyright

3.1 Reservation of rights

Ernst Schweizer AG reserves all rights to this document and the information contained therein. This document may not be reproduced, copied or made accessible to third parties in any form whatsoever, either in whole or in part, without the prior written consent of Schweizer. Furthermore, this document may not be used for purposes other than those for which it was provided to the recipient.

All appendices are integral parts of the installation instructions.

The PV mounting system was constructed in accordance with recognised safety regulations. However, improper use can endanger persons or cause material damage.

3.2 Liability

Liability is governed by the General Terms and Conditions of Ernst Schweizer AG, Hedingen (CH), and Ernst Schweizer GmbH, Satteins (AT), which can be retrieved at <https://ernstschweizer.com/de/agb/>.

4 Safety

4.1 Intended use

The MSP-PR PV mounting system is suitable for mounting photovoltaic modules on pitched roofs. Any other use is considered improper. Intended use also includes compliance with the information in these installation instructions. The information contained in the design documents must be observed.

Ernst Schweizer AG shall not be liable for damage resulting from non-compliance with the installation instructions, in particular the safety instructions, or from misuse of the product.

4.2 Reasonably foreseeable misuse

The reasonably foreseeable misuse described here does not claim to be exhaustive. If necessary, documented incidents should be added to the list.

These include

- Persons under suspended loads (during installation).
- Use of fittings and accessories such as screws or connectors when installing the supporting structure that are not originally included in the scope of delivery.
- Installation of the supporting structure by unauthorised, technically unqualified personnel.
- Damage to the roof covering.
- Installation of the supporting structure on a surface/roof unsuitable for load bearing.
- Incorrect positioning of the PV modules.
- When setting up the construction site on the roof, storing installation material on the roof and, when exiting the construction site, construction site material (tools, packaging material, pallets, installation and system material not yet installed, etc.) and unfinished systems must in all cases be adequately secured against the effects of the weather.
- A failure to observe safety equipment, safety regulations and common accident prevention regulations.
- The securing of unfinished systems when exiting the construction site.

Faults can also occur if unauthorised components are used during repairs.

4.3 Requirements for safe operation

To avoid injuries and material damage, care must be taken during all activities relating to the intended operation of the PV mounting system. Ernst Schweizer AG assumes no liability for any damage to property and/or injury in the event of non-compliance.

The following also applies:

- The PV mounting system must only be operated in a perfect functional condition.
- All warnings and safety instructions in these installation instructions and those of suppliers must be followed at all times.
- All changes to the PV mounting system of Ernst Schweizer AG are outside its responsibility and must be planned and realised by competent persons.

4.4 Responsibility of the customer or installer

The customer or installer is responsible for compliance with the following relevant items.

It must be ensured that

- All applicable accident prevention regulations and occupational safety provisions (or equivalent regionally valid standards) are complied with.
 - DGUV Regulation 1 – Principles of prevention (replaces BGV A1)
 - DGUV Regulation 3 – Electrical systems and equipment (replaces BGV A3)
 - DGUV Regulation 38 – Construction work (replaces BGV C22)
- Installation may only be realised by persons who have suitable basic and specialised technical knowledge.
- Persons entrusted with realising the work are able to assess the tasks assigned to them and identify possible risks.
- Persons entrusted with realising the work are familiar with the system components and installation process.
- The project report for the project to be installed has been read and fully understood by those persons entrusted with realising the work.
- The project report is available at all times during installation. The project report is an essential part of the Schweizer PV mounting system.
- Permissible installation conditions are observed. Schweizer cannot be held liable for damage or losses resulting from non-compliance with these conditions.
- Correct installation is in accordance with the project report, and the provision of the required tools is assured.
- A suitable lifting device is used for installation where appropriate.
- Components with visible damage are not used and are replaced.
- Each component and its accessories are used exclusively as intended and as specified in the project report.
- Only Schweizer MSP-PR or other specified MSP Schweizer components are used for installation, including where parts need to be replaced. No warranty claims will be recognised otherwise.
- Regular maintenance work is realised once a year, including an inspection of mechanical connections, wiring, earthing and the condition of the roof cladding.
- The roof on which the system is mounted is designed and built to adequately and safely support the PV mounting system. This includes the structural strength of the roof, the condition and compatibility of the roof structure and the covering, among other things. Schweizer cannot be held responsible for damage to roofs where the construction or design of the roof is not suitable for accommodating the system installation.
- The Schweizer MSP-FR-S PV mounting system can be incorporated into the design of the electrical equipotential bonding system and connected to it by correctly attaching a suitable earthing clamp or screw. The customer must ensure compliance with current rules, statutory provisions and guidelines.
- The installation complies with current national regulations and guidelines, including maintaining the required edge distance to the roof, installing safety barriers, restricting access during operations or taking precautions with regard to anticipated dynamic loads or particular events such as earthquakes and extreme weather conditions.
- Any existing lightning protection system on the building must be adapted in accordance with current technical regulations and statutory provisions.

The following standards (or corresponding regionally valid standards) must be observed for the design and installation of lightning protection, earthing and equipotential bonding:

- DIN EN 62305 Protection against lightning
- DIN VDE 0185 Parts 1–4 Protection against lightning
- DIN VDE 0100 Part 410 Earthing
- DIN VDE 0105 Operation of electrical installations
- DIN VDE 0298 Electrical cables

Furthermore:

- "Regulations of the Central Association of the German Roofing Trade (ZVDH)" or equivalent regionally applicable standards for working on roofs must be observed.
- DIN 18338 Roofing work
- DIN 18451 Scaffolding work

Also:

- The guidelines for damage prevention, VDS 2023 – Electrical installations in buildings with predominantly combustible building materials, and DIN 4102 – Fire behaviour of building materials and building components (or equivalent regionally applicable standards) must be observed.

4.5 Basic safety instructions

The following fundamental safety instructions and warnings are an integral part of these instructions and are of fundamental importance when handling this product:

- Work clothing must be worn that conforms to national regulations.
- Occupational safety regulations must be observed.
- It must be ensured that all electrical work is realised by qualified electricians. All relevant regulations and directives must be complied with.
- The presence of a second person who can provide assistance in the event of an accident is mandatory during the entire installation work.
- A copy of these instructions must be provided in the immediate vicinity of the system for use by persons assigned to realise the work.
- Until the PV system is fully completed and ready for operation, all incomplete sections, components and materials must be secured in accordance with applicable regulations.

5 Residual risks

The following safety instructions must be observed to avoid danger to people and damage to the PV mounting system and PV modules.

DANGER



Electric shock due to lightning striking the PV mounting system

The supporting structure with the mounted photovoltaic systems is operated outdoors. A lightning strike can result in life-threatening injuries.

Earth the PV mounting system properly.

Do not realise any maintenance or servicing work on the PV mounting system during a thunderstorm.

DANGER



Electrical voltage due to loosened protective conductors or earthing connections

If protective conductors or earthing connections have been disconnected, conductive parts including handles, covers and locks which appear to be insulated can cause an electric shock if touched. Check that all protective conductors and earthing connections are connected.

Leave the danger zone immediately in the event of electricity transferring to defective components or cables.

WARNING

Risk of falling

Carelessness and tripping may result in a fall when working at a height. The consequence of this may be life-threatening injuries.

- Access to the roof must be secured by the operator to prevent any unauthorised persons from trespassing on the roof area.
- When realising cleaning and maintenance work, ensure that suitable anchorage devices and a body-restraining device are available.

CAUTION

Risk of tripping and risk of falling

Objects lying around or cable ducts on the floor can cause tripping and falling hazards which can result in injuries.

- Avoid obstacles in the field of movement.
- Lay cable ducts so that no obstacles are created.
- Do not store or deposit any objects in the danger zone.

6 Technical clarification prior to commencing installation

The suitability of the roof for supporting a PV system must be checked and confirmed on site (structural engineer / specialist planner) in accordance with recognised rules, technology, legal requirements, standards and technical regulations.

The following points, among others, should be emphasised here:

- Sufficient load-bearing capacity for the fastenings and additional loads of the PV system
- Suitability and condition of the roof cladding
- Condition of the roof (free of any damage)

7 Roof preparation

The installer must ensure that installation conditions required for the MSP-PR are met and that persons responsible for the installation work are professionally trained and completely familiar with the PV mounting system.

NOTE



The material must be distributed on the roof in a manner that avoids excessive localised loading.

8 Commissioning and maintenance

Installation and commissioning may only be realised by authorised personnel.

Observe the safety instructions listed here and the indications at the beginning of these operating instructions in **Chapter 4 Safety**.

Regular maintenance work is realised once a year, including an inspection of screw connections, mechanical connections, the position of protective layers, wiring, earthing and the condition of the roof cladding.

9 Installation conditions

The MSP-PR PV mounting system from Schweizer is designed for the following conditions:

- Installation of the system must be correctly adapted to the project and its local conditions. This includes the calculation of additional loads.
- The module sizes correspond to the specifications in the MSP-PR data sheet.
- Suitable for ambient conditions within the range of normal corrosive environments (e.g. at least 1 km from the seashore) and in more corrosive environments (e.g. C4), if regular maintenance is ensured.
- For roofs that can adequately withstand the additional load of the PV mounting system (as assessed by the customer and within the customer's remit).
- Roofs checked for damage. Any damage and its repair must be clarified before installation.
- After checking that the plans (including the assumption regarding loads) correspond to the conditions on site. In the event of deviations from the defined operating conditions, planning must be revised before installation begins.

10 Additional documents

Document type	Designation	File
Installation instructions	MSP-PR PV mounting system	Installation instructions MSP-PR
Information leaflet	MSP-PR data sheet	Data sheet MSP-PR
Information leaflet	MSP-PR on-site fasteners and components	Information sheet for on-site fasteners and components
Information leaflet	Sealing the fasteners of counter battens	
Information leaflet	Earthing terminals	Information leaflet for earthing clamps

11 Required tools



Cordless screwdriver



If the cordless screwdriver is equipped with an impact drilling function, this must be switched off.



T 30

Torx attachment TX30

















Torque spanner (10 Nm) for/with Torx attachment TX30


Installation instructions for stainless steel screw connections:

The installation must be realised professionally. To avoid cold welding between the bolt and nut, adhere to the following:

- use a cordless screwdriver without an impact drilling function
- set an appropriate speed that is not too high
- do not generate increased pressure on the screw

12 Components

1	2	3	4	5
				
Base plate MSP-PR-BP	Spacer plate MSP-PR-SP -	Wood screw MSP-PR-HS	Roof hook MSP-PR-RHA MSP-PR-RHC MSP-PR-RHF MSP-PR-RHL	Carrier profile MSP-PR-CH
6	7	8	9	10
				
Rail connector MSP-PR-SL	End clamp MSP-PR-EC MSP-PR-ECB abZ-14.4-92	Middle clamp MSP-PR-MC MSP-PR-MCG MSP-PR-MCB MSP-PR-MCBG abZ-14.4-92	Cross connector MSP-PR-CC	Adapter plate MSP-PR-HBP
11	12	13	14	
				
Hanger bolt MSP-PR-HB	Sheet metal seam clamp MSP-PR-SC 70	Stainless steel saddle MSP-PR-SCC 40	SPT Project report	

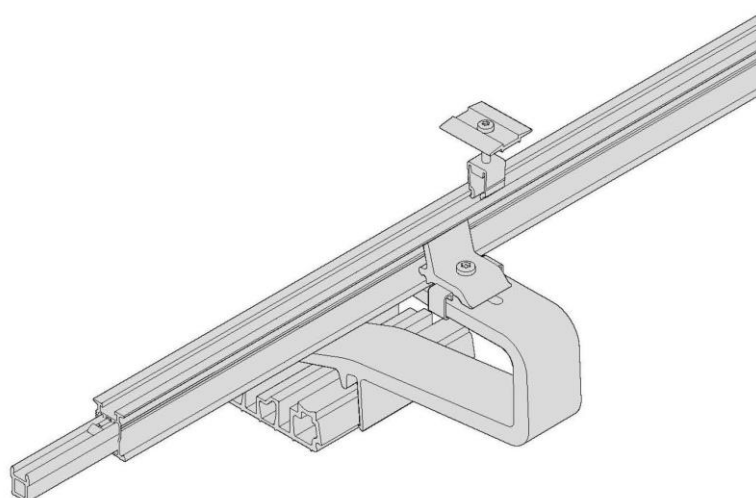

Solar Systems from Schweizer

PV Mounting System Installation Instructions

Pitched Roof MSP-PR




13 Preparation – the following must be realised before assembly:

- The SPT project report must be available.
- The material required must be complete.


Options:

- **Cross connector** Appendix 1 Mounting cross connector MSP-PR-CC Page 17
- **Hanger bolt** Appendix 2 Mounting hanger bolt MSP-PR-HB Page 18
- **Adapter plate** Appendix 3 Mounting adapter plate MSP-PR-HBP Page 19
- **Sheet metal seam clamp** Appendix 4 Mounting sheet metal seam clamp MSP-PR-SC 70 Page 20


14 Assembly

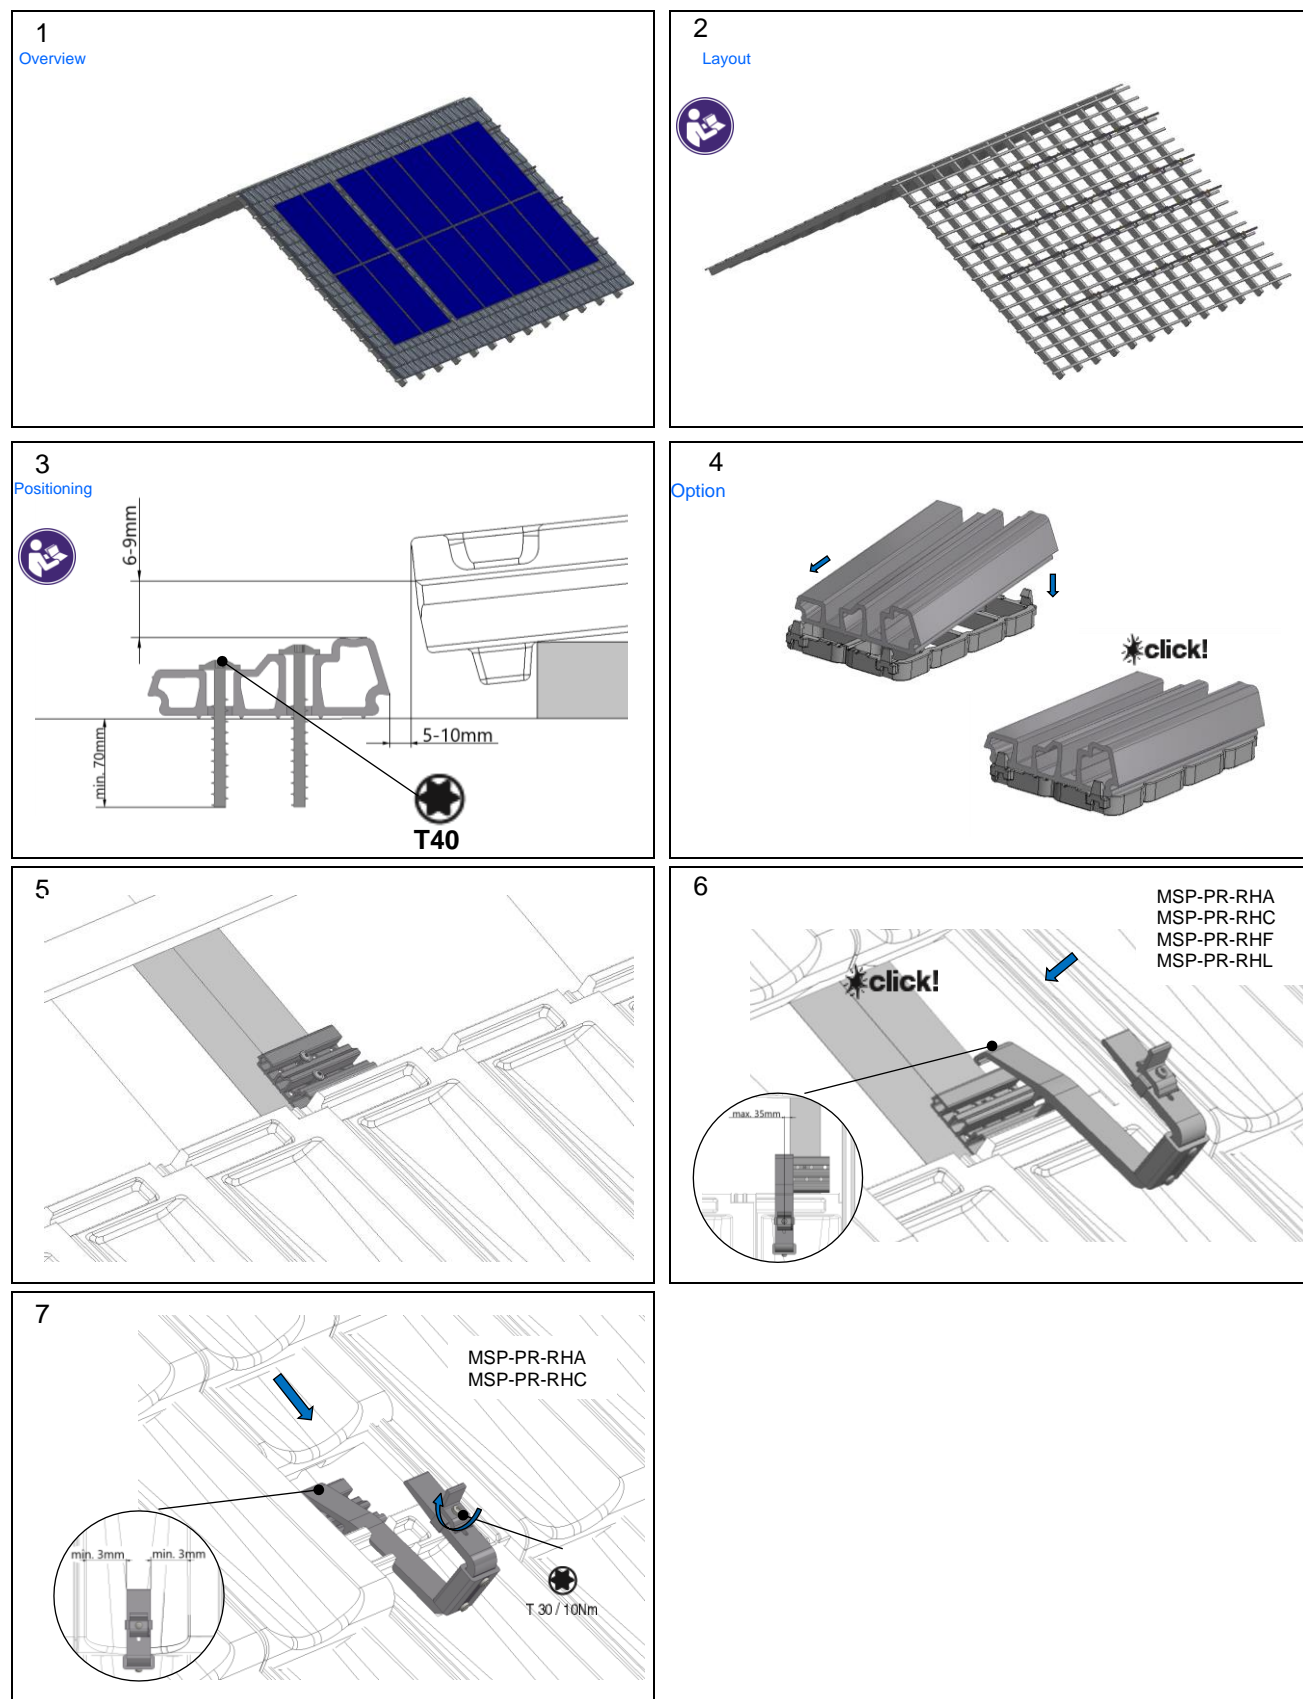


8 MSP-PR-RHA
MSP-PR-RHC
MSP-PR-RHF
MSP-PR-RHL

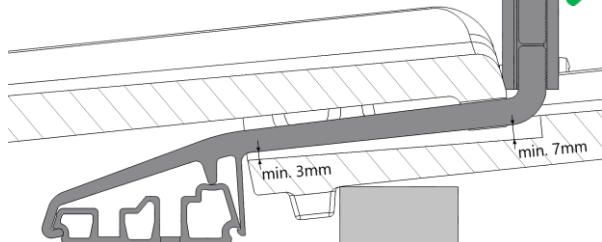

8.1 MSP-PR-RHA
MSP-PR-RHC
MSP-PR-RHF
MSP-PR-RHL

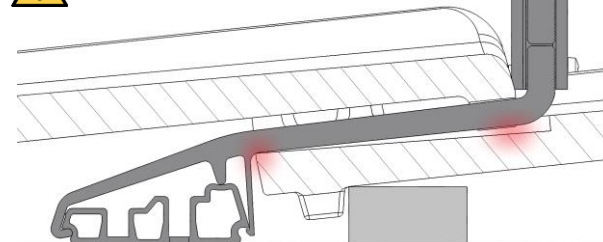


9

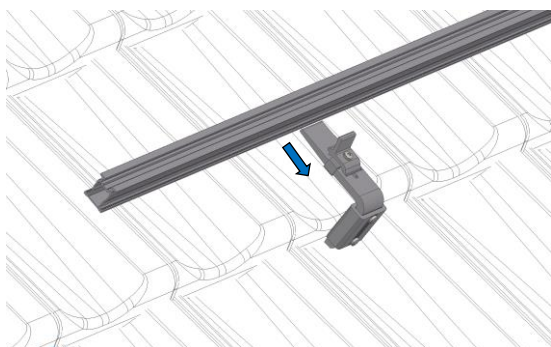


10


T 30 / 10Nm

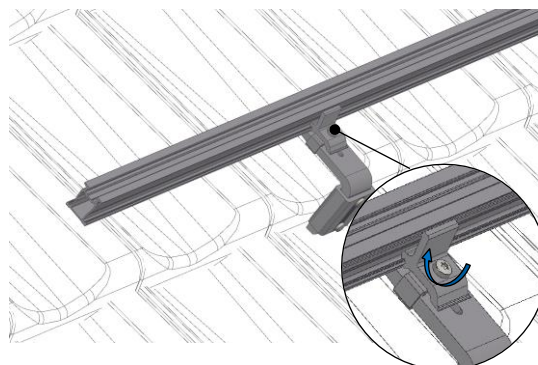

11

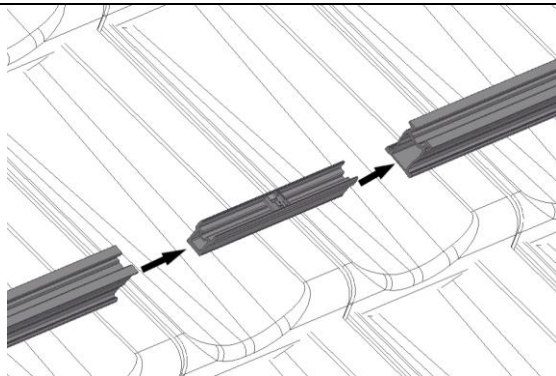


12

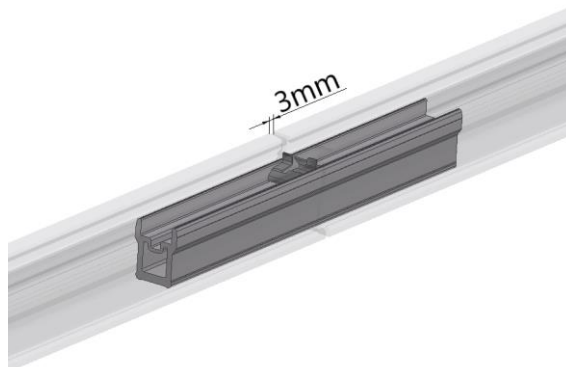

13


End clamp


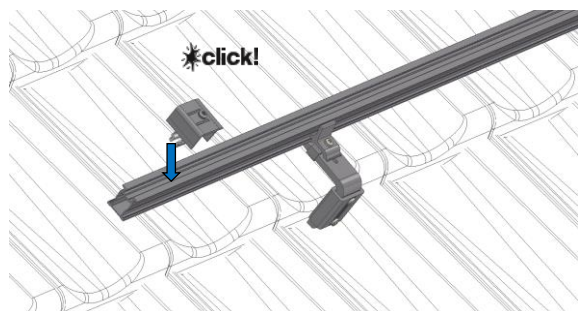


14



End clamp

T 30 / 10Nm

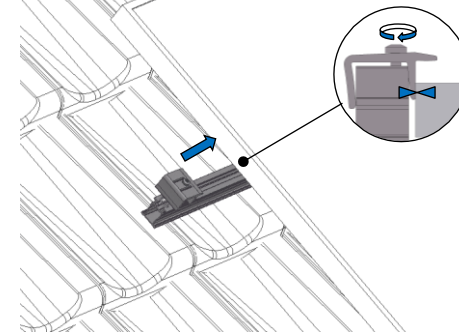


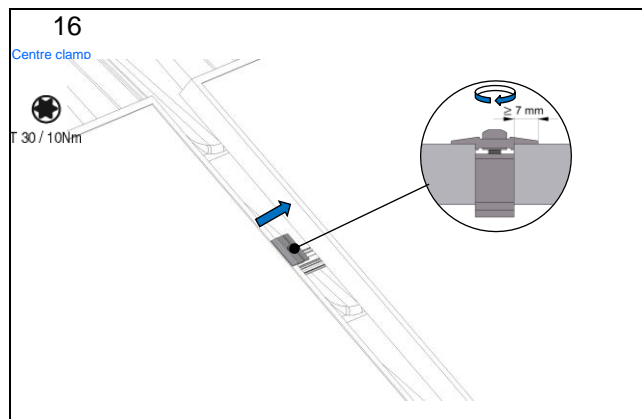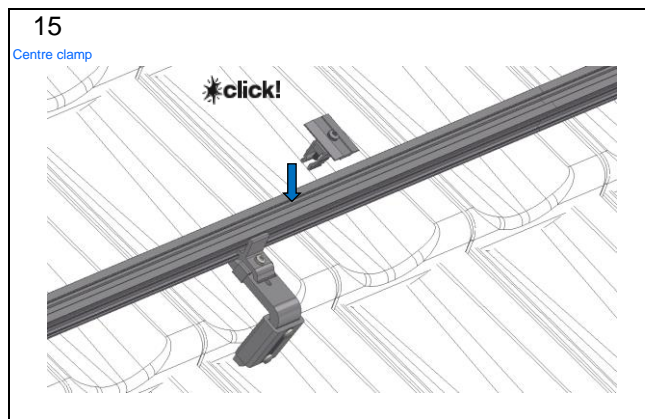

14.1 Detail of dilatation joint support profile MSP-PR-CH

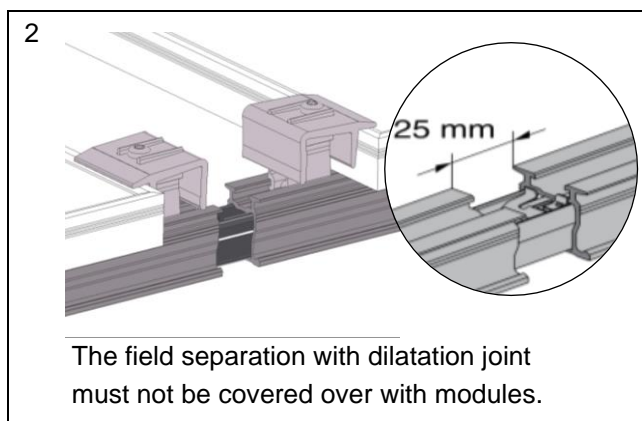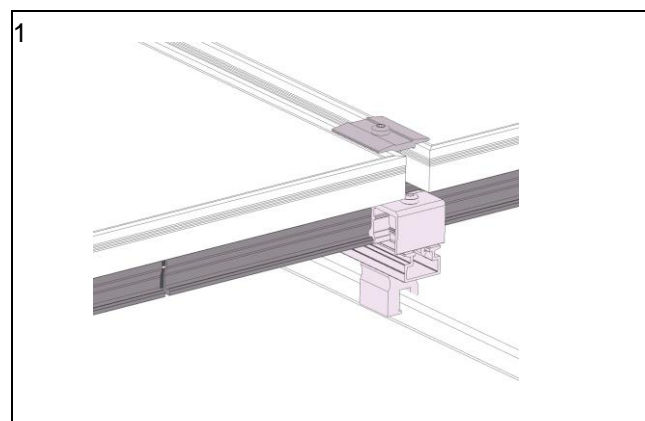

15 Appendix 1 Mounting cross connector MSP-PR-CC

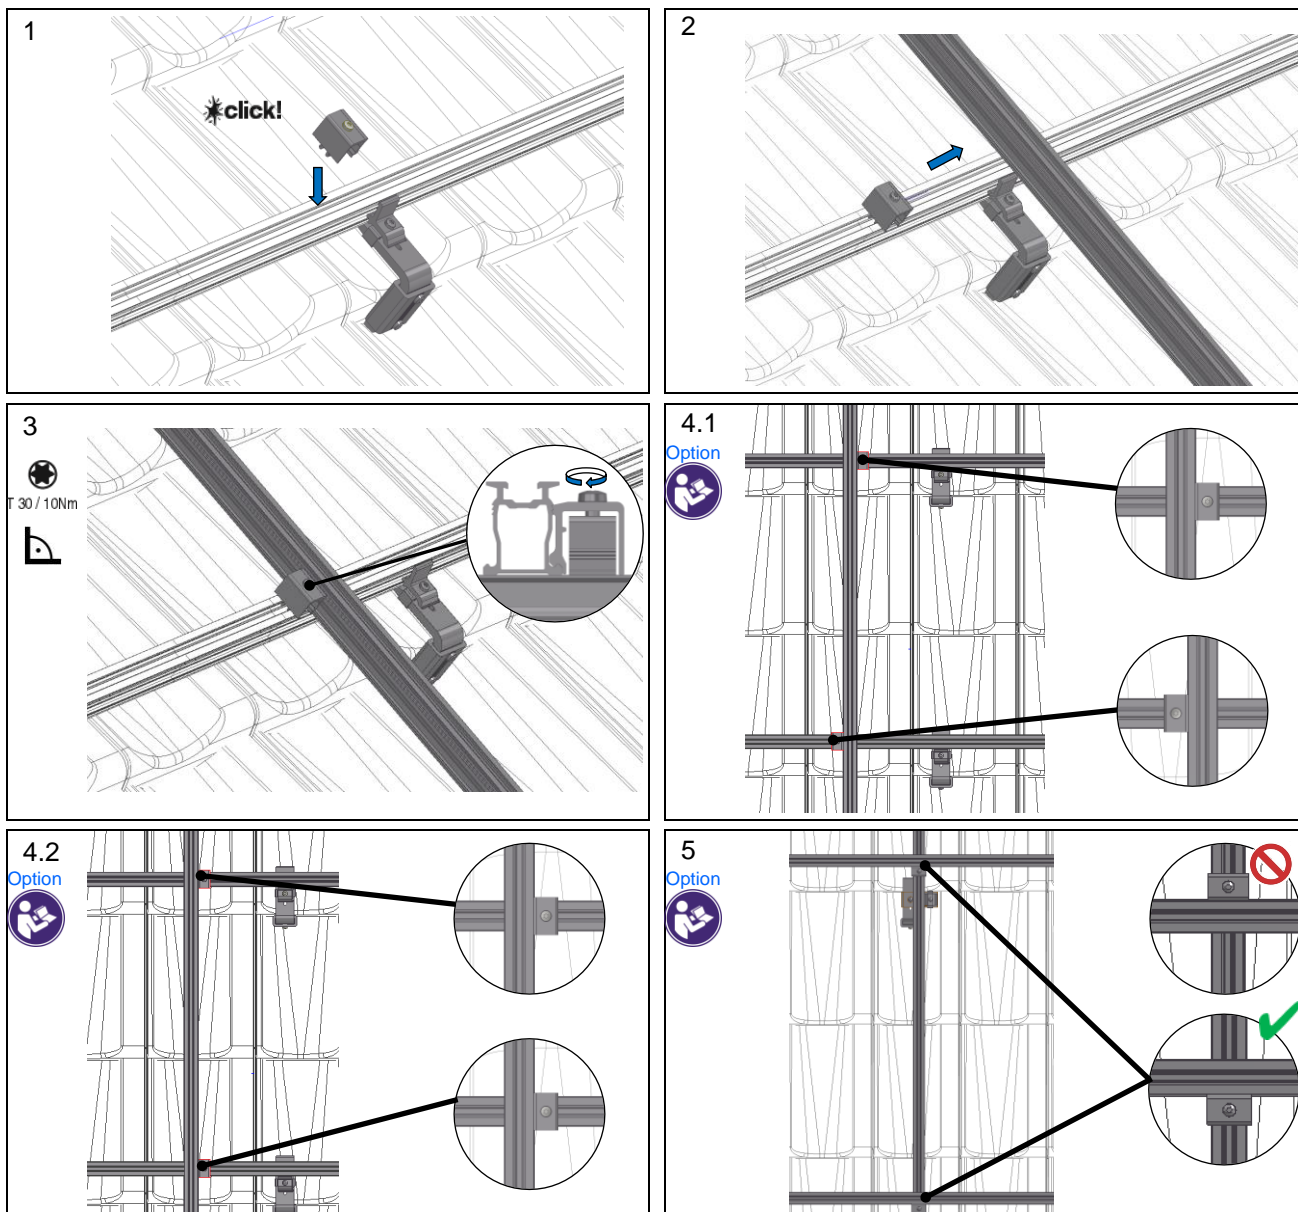

16 Appendix 2 Mounting hanger bolt MSP-PR-HB

1

Overview

MSP-PR-HB

MSP-PR-HB	
10x200 A2	
12x200 A2	
12x300 A2	

M10 7 mm
M12 9 mm
M10 15 mm
M12 18 mm

2

MSP-PR-HB	ø D [mm]
10x200 A2	14
12x200 A2	16
12x300 A2	16

90°
øD

3


MSP-PR-HB	ø d [mm]
10x200 A2	7.0
12x200 A2	8.5
12x300 A2	8.5

90°
ød


4


min. 75 mm

17 Appendix 3 Mounting adapter plate MSP-PR-HBP

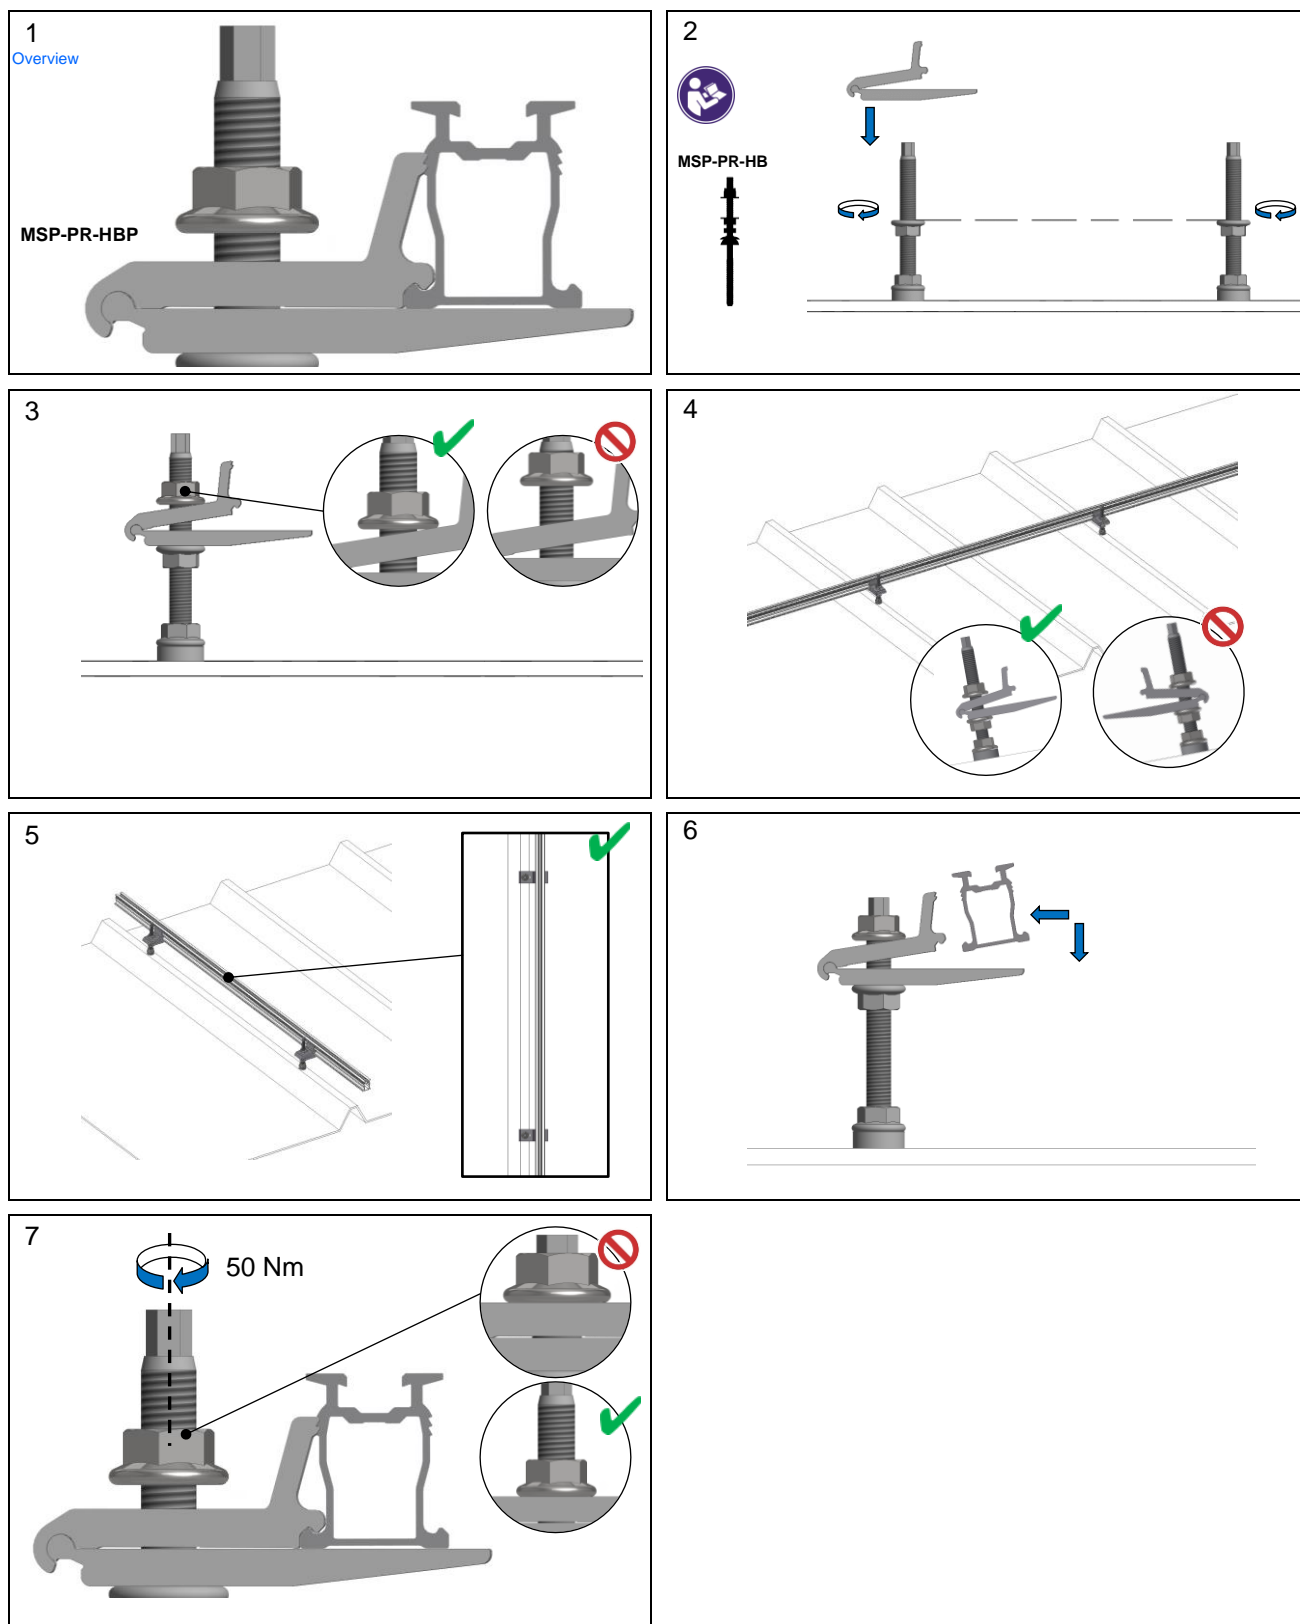


18 Appendix 4 Mounting the sheet metal clamp MSP-PR-SC 70

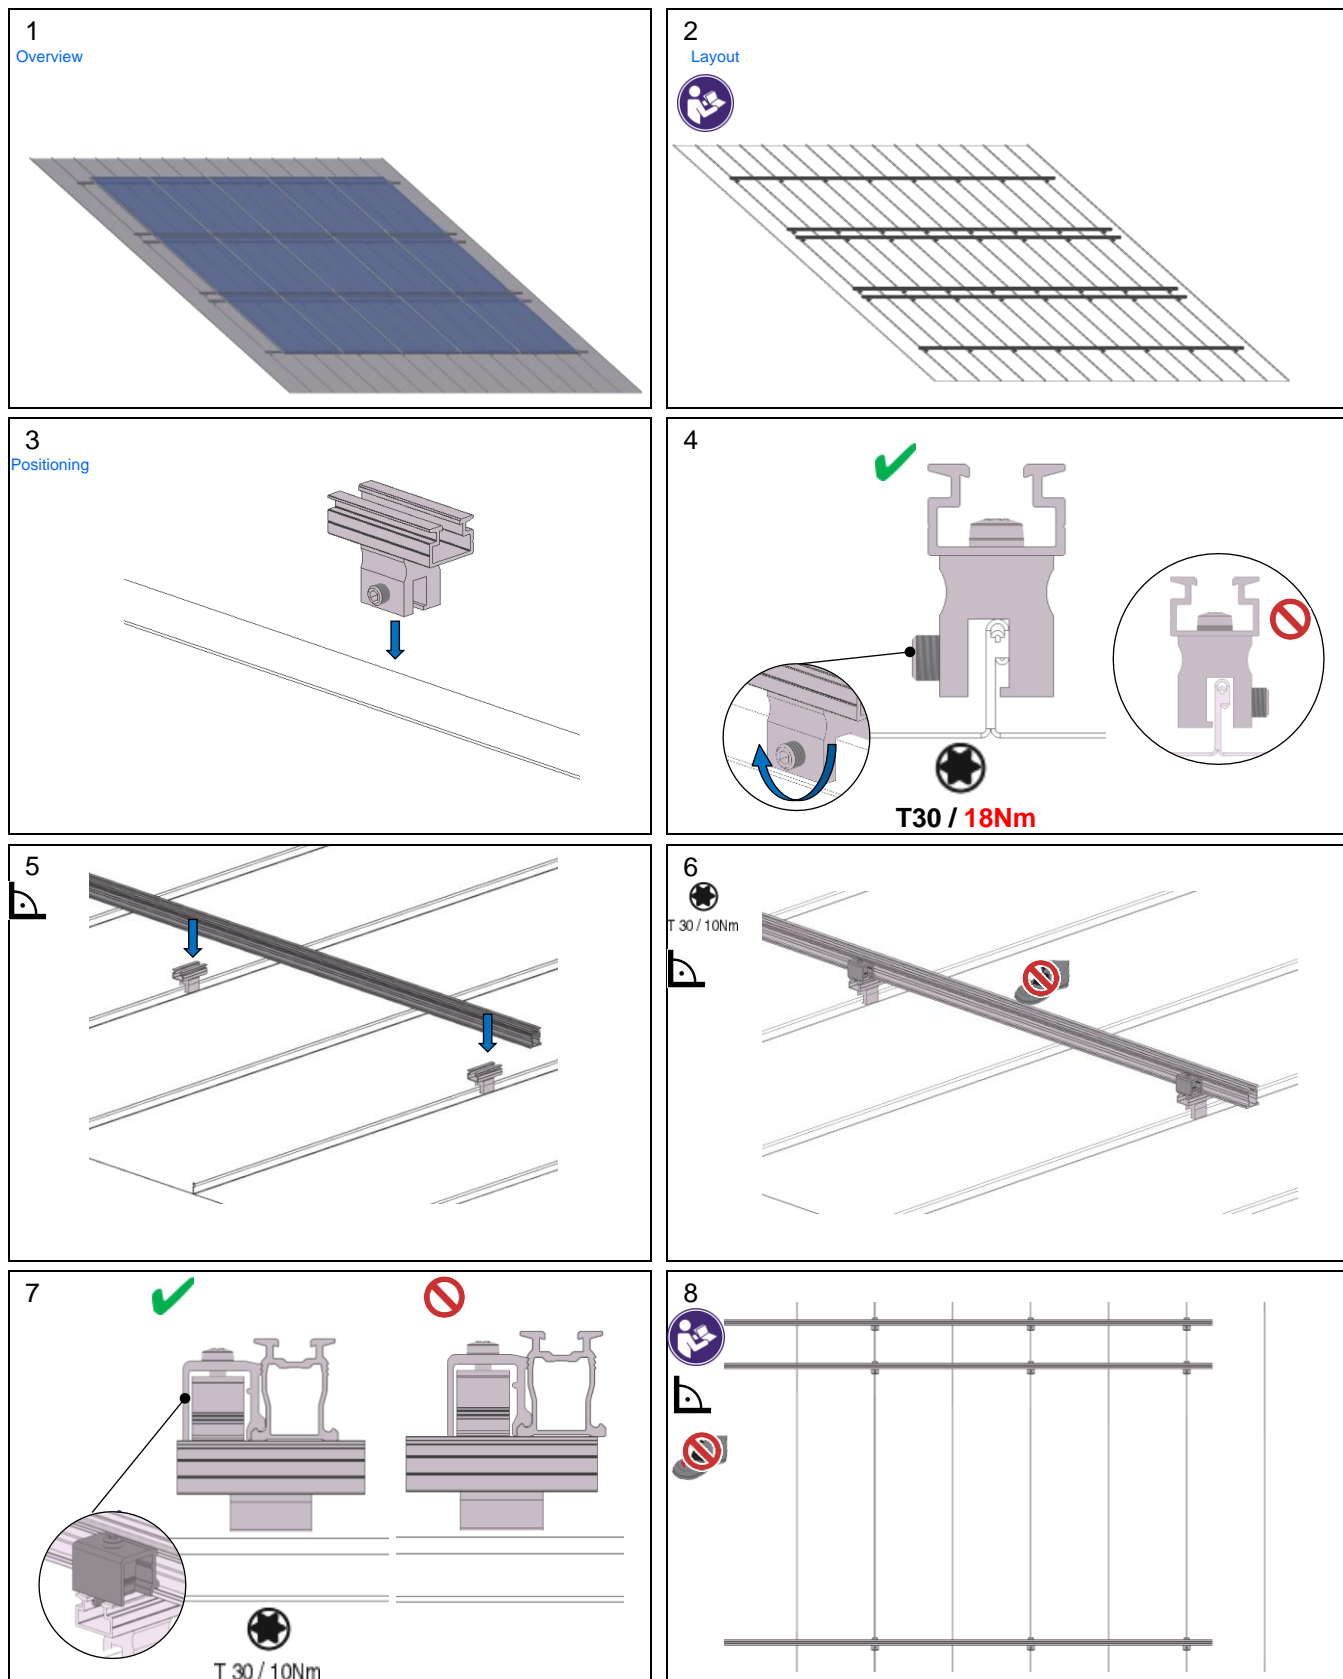

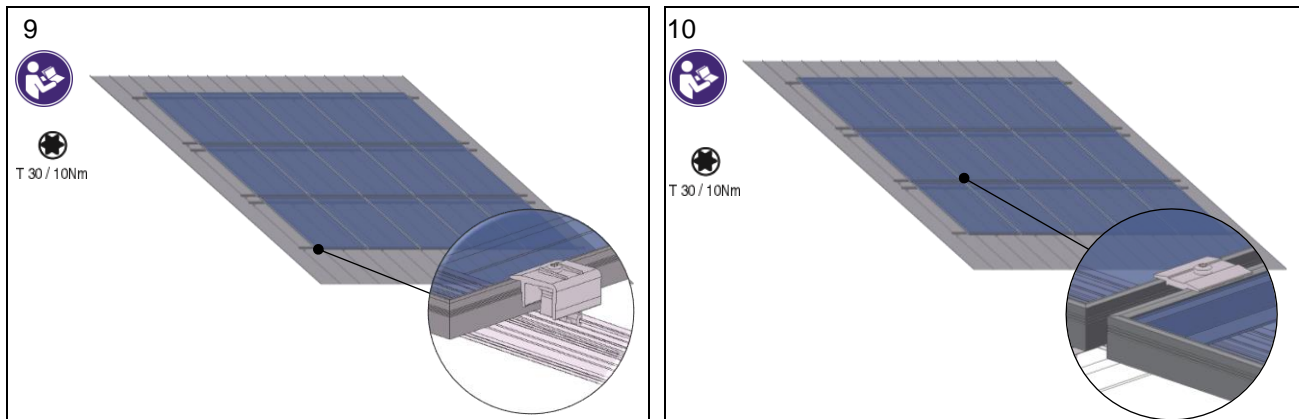

18.1 Appendix 5 Installation of sheet metal seam clamp MSP-PR-SC 70 on a copper roof with a stainless steel saddle MSP-PR-SCC 40

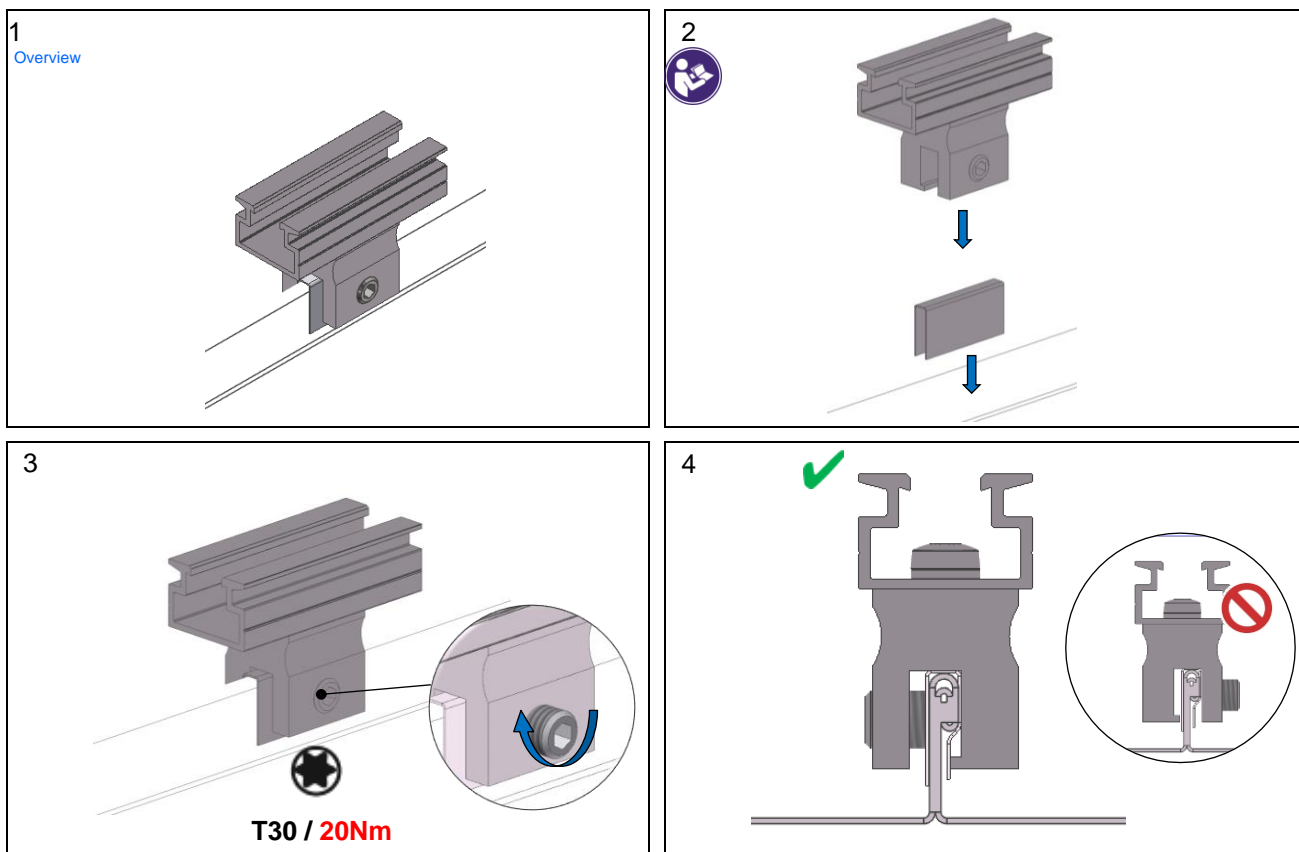

18.2 Note on mounting the stainless steel saddle MSP-PR-SCC 40

- The stainless steel saddle is only required in conjunction with a copper roof in order to avoid contact corrosion.
- The double standing seam made of copper may be a maximum of 3.5 mm thick (sheet thickness 0.7 mm).